


**PARTIAL ELEVATION (LEFT SECTION)  
BASEBALL BACKSTOP**

**SECTION**

Size of pipe:	Weight per foot (Lbs.)
1-1/4"	2.27
1-1/2"	2.72
2"	3.65
2-1/2"	5.79
3-1/2"	9.11

**NOTES:**

1. All pipe and post sizes are nominal diameter (N.D.) .
2. Pipes, posts, stretcher bars, bands, fabrics, etc. shall be hot-dip galvanized.
3. Pipe connections shall be welded and painted with Z.R.C. cold galvanizing compound.
4. Fabric shall be fasten to and corner posts by stretcher tension bars and tension bands spaced approximately 15" apart.
5. Wire fastenings shall be No. 12 gauge galvanized tie wire.
6. Overhang wire fastenings shall be spaced 12" apart.
7. Line post wire fastenings shall be spaced 14" apart.
8. Horizontal brace wire fastenings shall be spaced 18" apart.
9. Home plate and pitcher's plate and skinned area not in contract.
10. No splicing shall be allowed on all straight-run pipes except for line, corner, brace or end posts (one splice only). See splicing detail on drawing No. B-7.

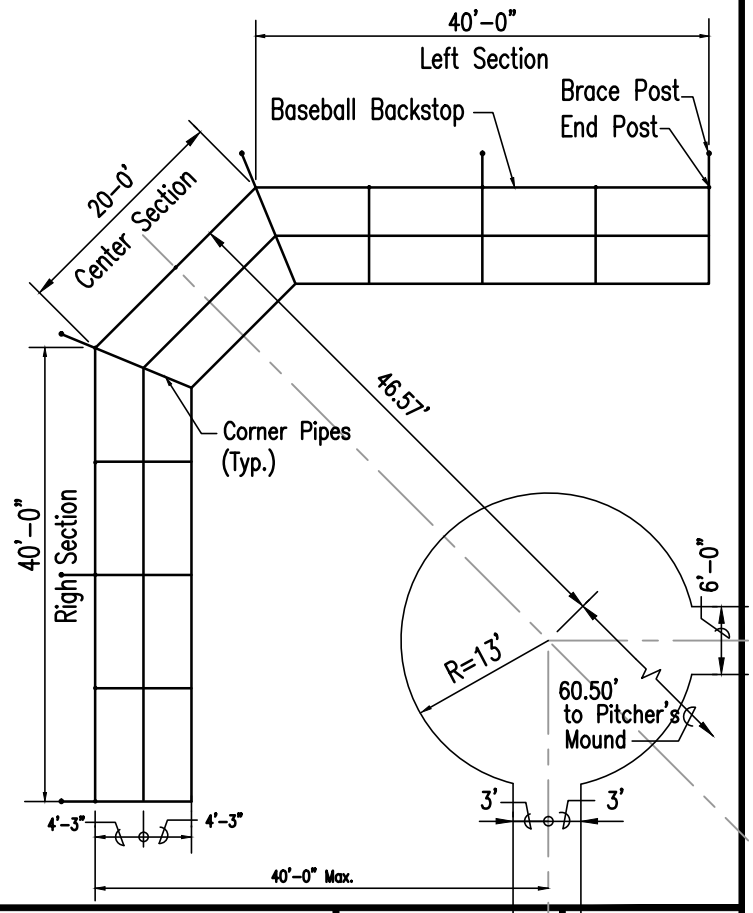

CITY COUNTY OF HONOLULU

**BASEBALL BACKSTOP  
(TYPE "B")**

SCALE: NOT TO SCALE

REVISED: AUG. 1993

STANDARD  
DETAILS

**B-3**